



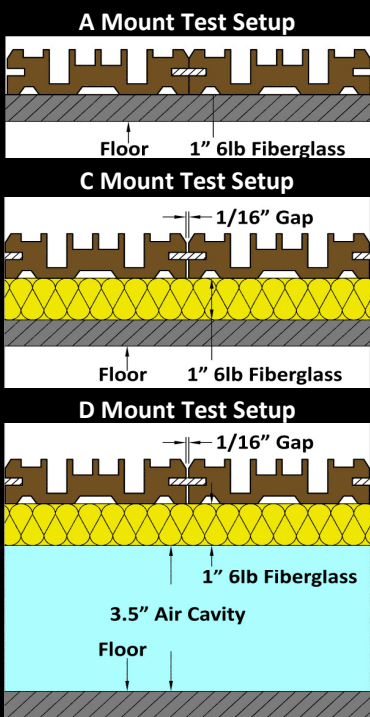

FlutterFree® Supplemental Random Incidence Absorption Data

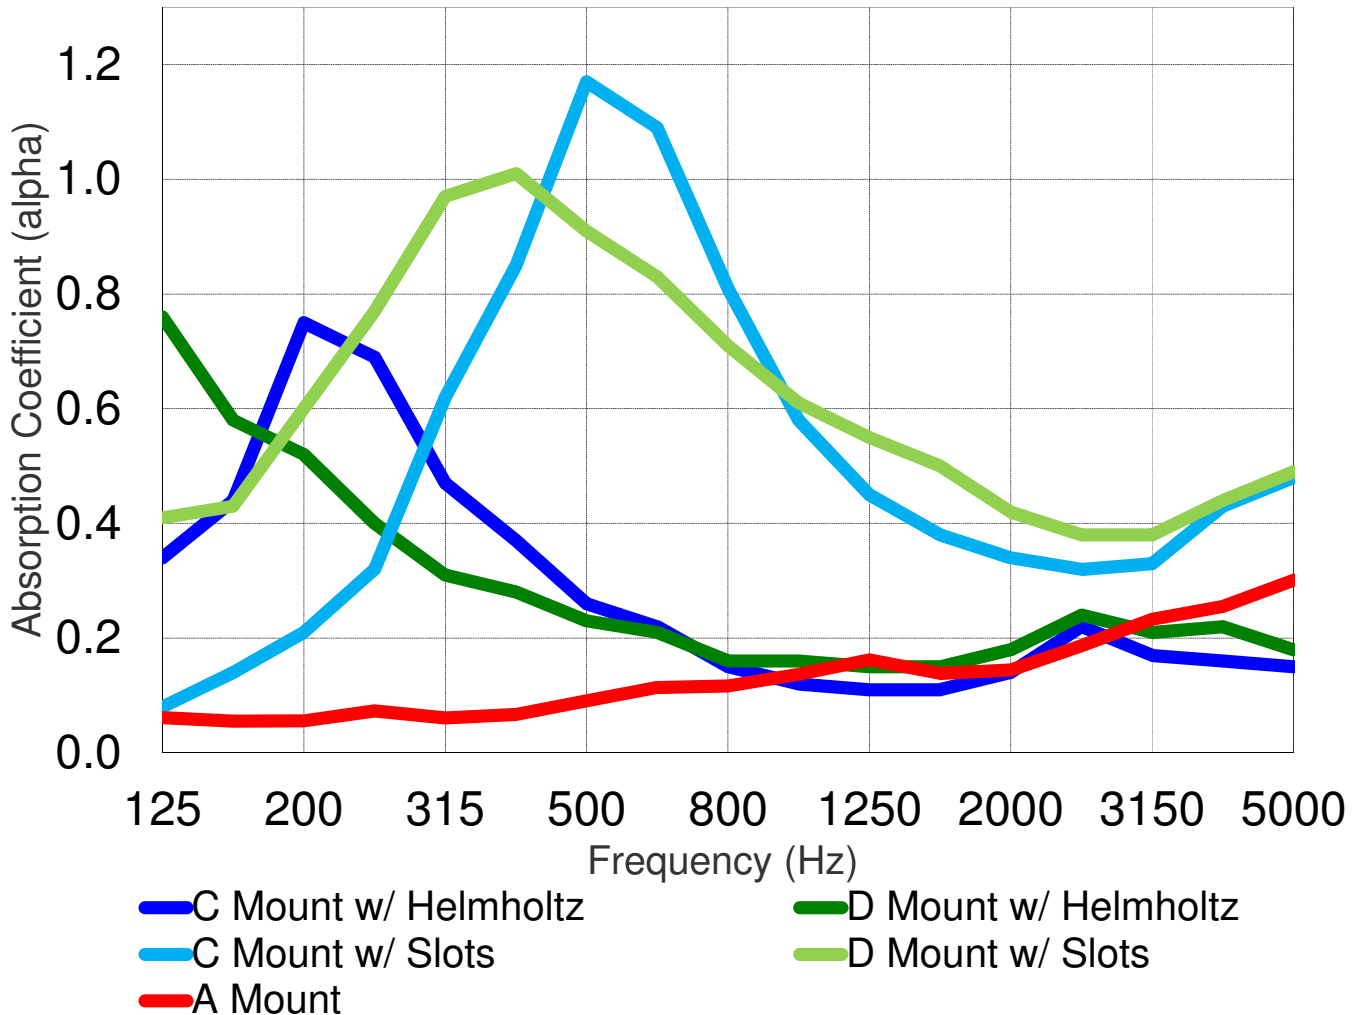

FREQ	A Mount	C Mount w/ Helmholtz	C Mount w/ Slots	D Mount w/ Helmholtz	D Mount w/ Slots
125	0.06	0.34	0.08	0.76	0.41
160	0.06	0.44	0.14	0.58	0.43
200	0.06	0.75	0.21	0.52	0.60
250	0.07	0.69	0.32	0.40	0.77
315	0.06	0.47	0.62	0.31	0.97
400	0.07	0.37	0.85	0.28	1.01
500	0.09	0.26	1.17	0.23	0.91
630	0.11	0.22	1.09	0.21	0.83
800	0.12	0.15	0.81	0.16	0.71
1000	0.14	0.12	0.58	0.16	0.61
1250	0.16	0.11	0.45	0.15	0.55
1600	0.14	0.11	0.38	0.15	0.50
2000	0.14	0.14	0.34	0.18	0.42
2500	0.19	0.22	0.32	0.24	0.38
3150	0.23	0.17	0.33	0.21	0.38
4000	0.25	0.16	0.43	0.22	0.44
5000	0.30	0.15	0.48	0.18	0.49