



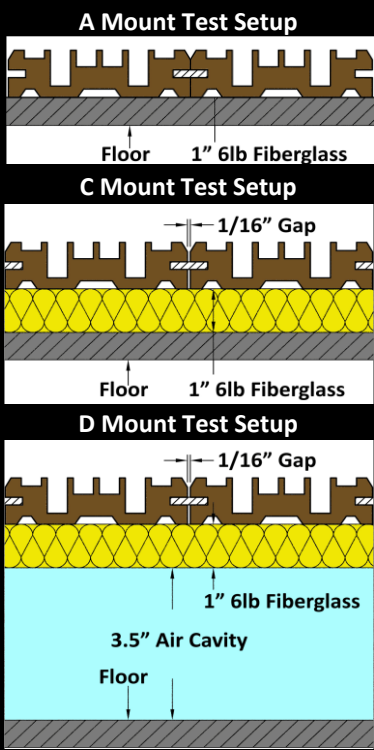

ACOUSTICAL SYSTEMS - LLC

# FlutterFree® Plank Supplemental Random Incidence Absorption Report

06/16/26

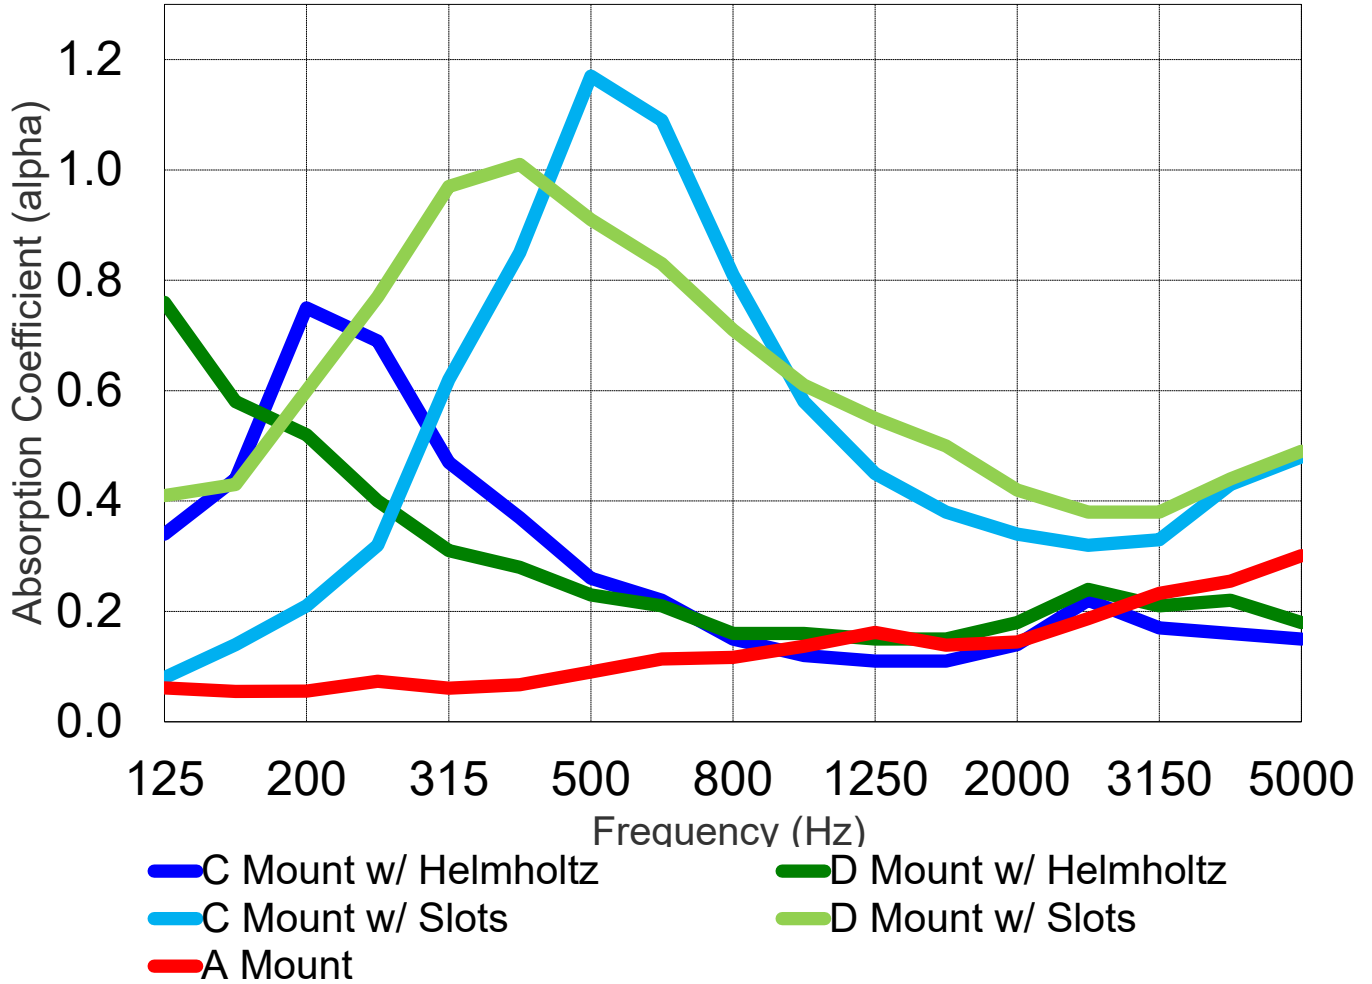

FREQ	A Mount	C Mount w/ Helmholtz	C Mount w/ Slots	D Mount w/ Helmholtz	D Mount w/ Slots
125	0.06	0.34	0.08	0.76	0.41
160	0.06	0.44	0.14	0.58	0.43
200	0.06	0.75	0.21	0.52	0.60
250	0.07	0.69	0.32	0.40	0.77
315	0.06	0.47	0.62	0.31	0.97
400	0.07	0.37	0.85	0.28	1.01
500	0.09	0.26	1.17	0.23	0.91
630	0.11	0.22	1.09	0.21	0.83
800	0.12	0.15	0.81	0.16	0.71
1000	0.14	0.12	0.58	0.16	0.61
1250	0.16	0.11	0.45	0.15	0.55
1600	0.14	0.11	0.38	0.15	0.50
2000	0.14	0.14	0.34	0.18	0.42
2500	0.19	0.22	0.32	0.24	0.38
3150	0.23	0.17	0.33	0.21	0.38
4000	0.25	0.16	0.43	0.22	0.44
5000	0.30	0.15	0.48	0.18	0.49